


(+24VDC) - Comes from Computer Control Enclosure for status.

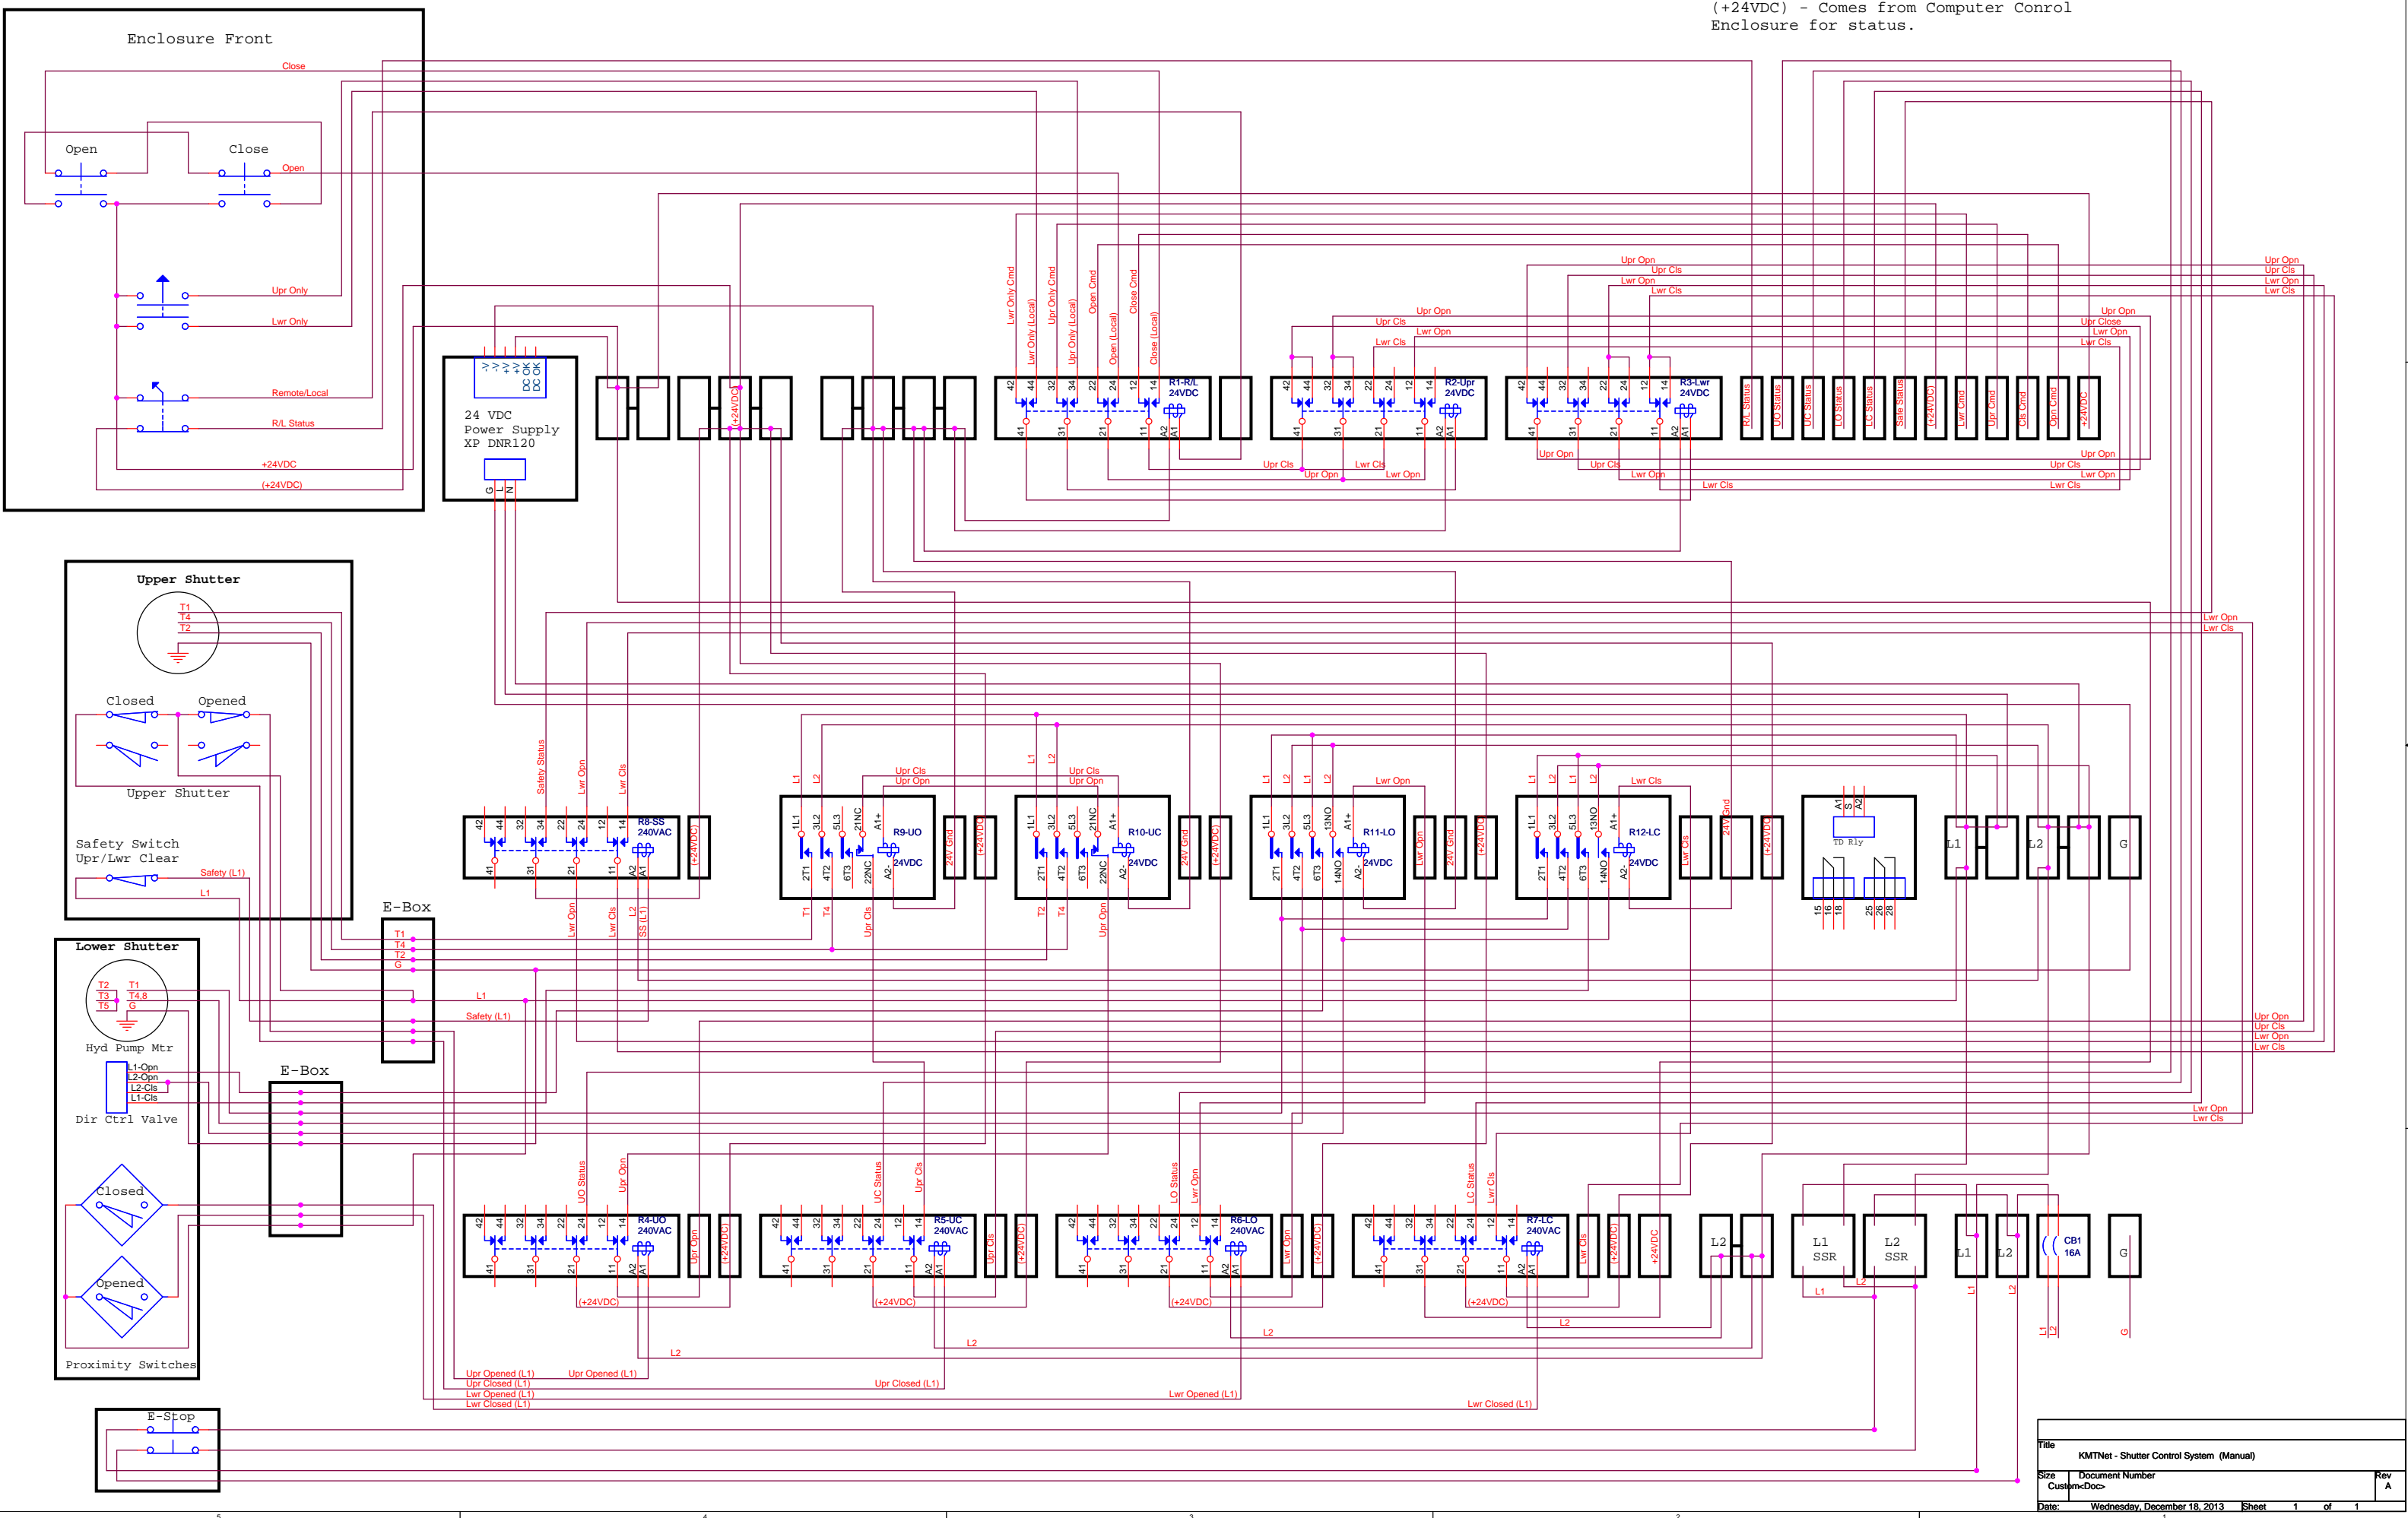

Title	KMTNet - Shutter Control System (Manual)		
Size	Document Number		Rev
Custom<Doc>			A
Date:	Wednesday, December 18, 2013	Sheet	1 of 1